


# Smart3G 5732P Wiring Configuration

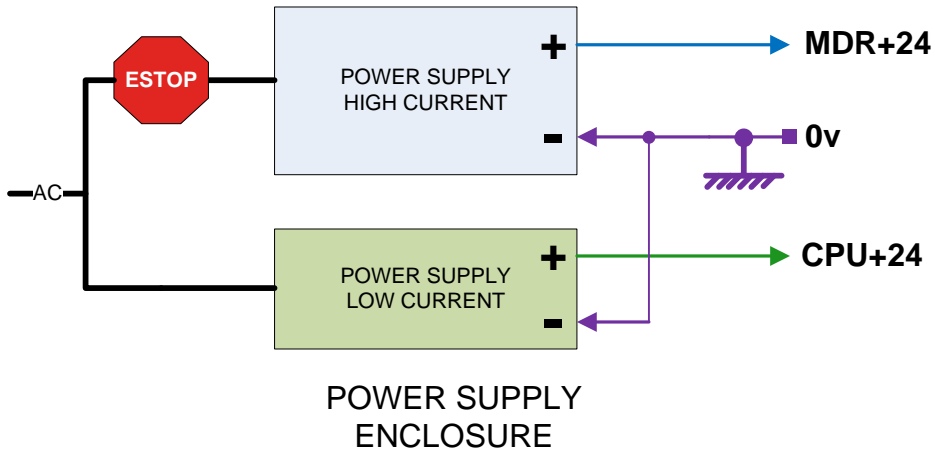

Note:  
 This Diagram shows Dual Power Supply Configuration. Single Power Supply can also be used.

With Dual Power Supply, MDR can be powered via E-Stop circuit. In case E-Stop is tripped, all motors are disabled, while the PLC and inputs are still operational.

In addition to I/O status, the MDR Power Supply On/Off Status is also available via Ethernet/IP Network Protocol.

